


# CLO<sub>2</sub>IX<sup>®</sup> INDUSTRIAL CHLORINE DIOXIDE GENERATOR

for

## CONTINUOUS CLEANING OF WETTED SURFACES

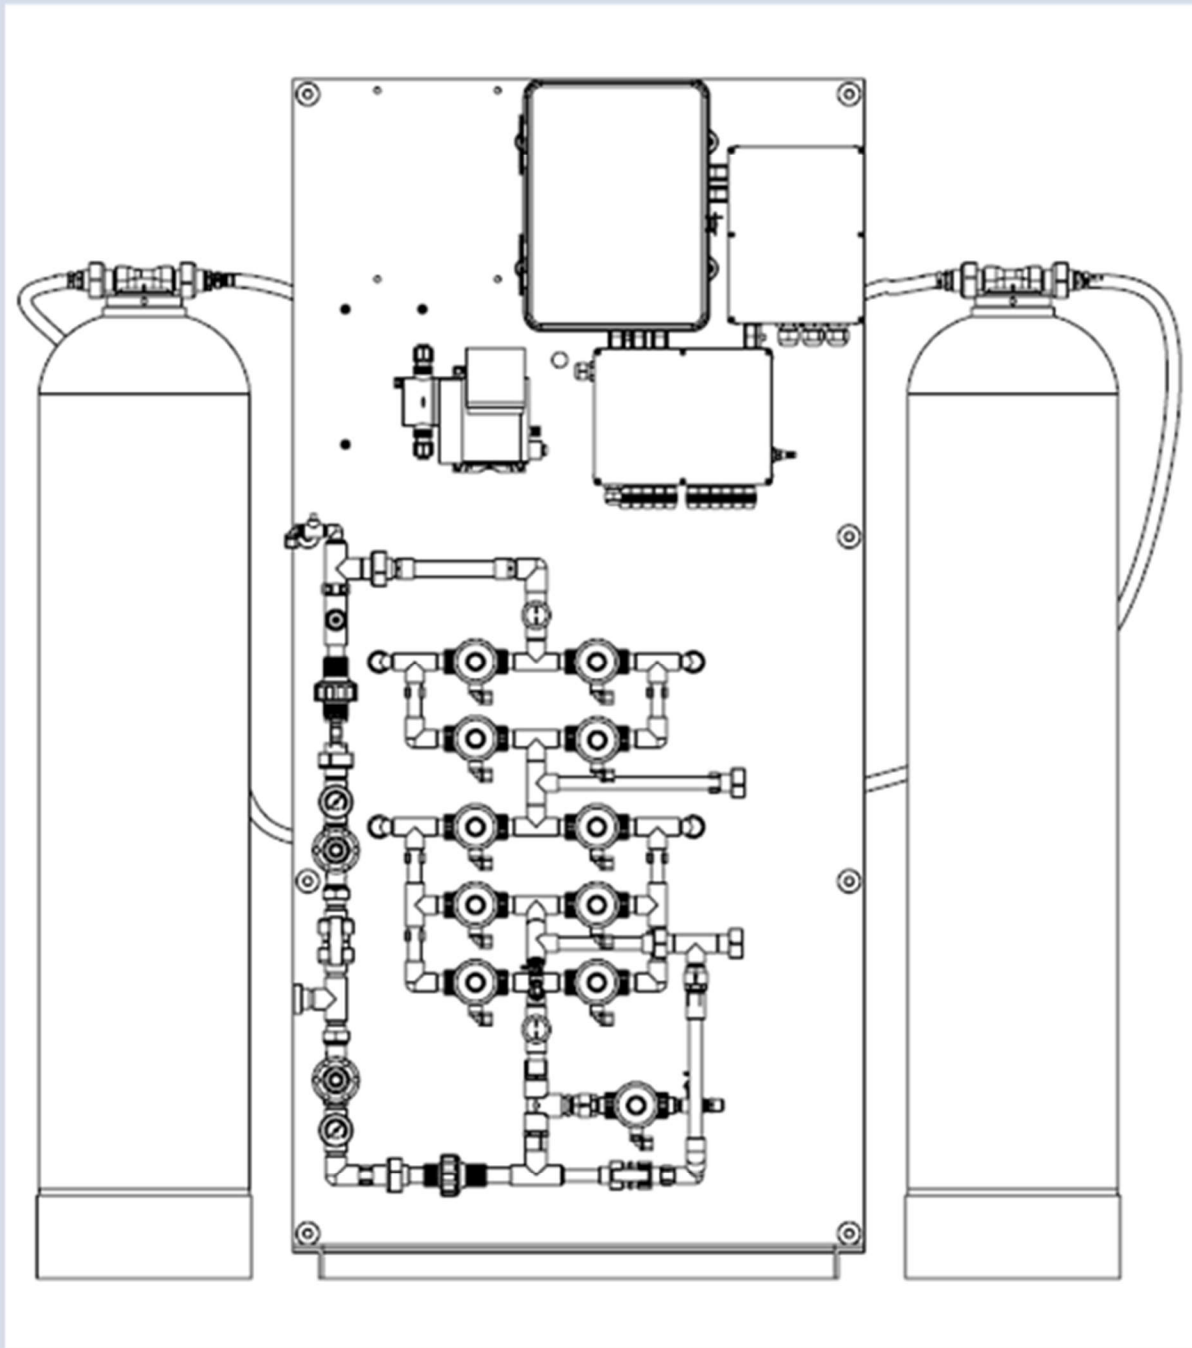

IND 100-200

10 lb/day – 20 lb/day

WHAT IS ON YOUR PIPES IS IN YOUR PRODUCT!

# U.S. Units

---

## Performance Specifications

	<u>Industrial IG-100</u>	<u>Industrial IG-200</u>
ClO <sub>2</sub> Production:	10 lb/day	20 lb/day
ClO <sub>2</sub> Max Vol. Production:	2,378 gal Soln. /day	4,755 gal Soln. /day
Nominal Flow Rate:	1.32 gal/min	2.64 gal/min
Peak Production Flow Rate:	1.65 gal/min	3.30 gal/min
Max Unit Flow Rate During Regen:	4.76 gal/min	6.41 gal/min
Estimated Water Consumption:	2,036 gal / 1,902 gal ClO <sub>2</sub> Soln. Produced	3,938 gal / 3,804 gal ClO <sub>2</sub> Soln. Produced

---

## Operating Parameters

Prime Flow Rate:	3.96 gal/min
Rinse Flow Rate:	0.41 gal/min
Feed Water Quality:	Potable Water (< 500 ppm TDS)
Maximum Conductivity:	1,000 µS
Ambient Temperature Range:	40°F - 110°F
Water Temperature Range:	50°F - 90°F
ClO <sub>2</sub> Conversion:	≥ 75% @ 77°F
NaClO <sub>2</sub> Usage:	1 gal / 230 gal ClO <sub>2</sub> Soln. Produced
Max HCl 31.45% Usage:	1 gal / 514 gal ClO <sub>2</sub> Soln. Produced
Max HCl 10% Usage:	1 gal / 149 gal ClO <sub>2</sub> Soln. Produced
Max H <sub>2</sub> SO <sub>4</sub> 35% Usage:	1 gal / 514 gal ClO <sub>2</sub> Soln. Produced

---

## Remote Access Ports

Ethernet Communication Port

System can be connected to a customer-provided cell modem or directly into the facility's network.

---

## Dimensions

Generator w/ IX Tanks:	63" (W) x 30" (D) x 74" (H)
Frame:	30" (W) x 30" (D) x 74" (H)
IX Tank:	15" (W) x 15" (D) x 68" (H)

## Weights

Shipping Weight:	900 lb
Operating Weight:	1,200 lb

## Plumbing Connections on Generator

Inlet Water:	3/4-inch Spears Union FPT
Product HClO <sub>2</sub> :	1/2-inch Spears Union FPT
Drain:	1/2-inch Spears Union FPT
Inlet NaClO <sub>2</sub> :	3/8-inch PVDF Tubing
Inlet Regenerant:	3/8-inch PVDF Tubing
Compressed Air:	1/4-inch FPT Plug

NOTE: Connection of hoses or hard plumbing to unit based on local plumbing codes.

---

## Installation Plumbing Requirements

Inlet Pressure:	40-100 psig
ΔP Across System:	25 psig
Drain Pressure:	Atmospheric

## Installation Electrical Requirements

90-240 VAC 2.7A 50-60 Hz

---

## Compressed Air Requirements

Air Quality:	Filtered & Regulated Air
Pressure:	100 psig

## Precursor Requirements

NaClO <sub>2</sub> :	25% active
Regenerant HCl:	10% or 31.45%
Regenerant H <sub>2</sub> SO <sub>4</sub> :	35% (may be used with softened water instead of HCl)

NOTE: All systems shipped dry and chemical-free. Receiver responsible for obtaining and applying all precursors.

---

## Supplied With Generator

Unit Hoses

Pre-Filter - 10" housing with 30 micron filter

Post Filter - 10" housing with 5 micron filter

---



Dripping Wet Water ClO<sub>2</sub>IX® units are tested and certified to NSF/ANSI 51 and 61. See [www.wqa.org](http://www.wqa.org) for any specific product details.

Dripping Wet Water  
413 W. Nakaoma  
San Antonio TX 78216  
(210) 384-0805 Fax (210) 525-8883  
[www.clo2ix.com](http://www.clo2ix.com)

ClO<sub>2</sub>IX®